

WRWSD WATER SERVICE TAP AGREEMENT

I, _____, request Waynoka Regional Water and Sewer District to install water service tap for Lot # _____, for which I agree to pay the sum of 2000.00 (effective 3-1-2005). I have received and read the plumbing code requirements of the of the Waynoka Property Owners Association, Inc. Building Code and agree to the conditions set for the therein.

Date: _____

Signed: _____

Check #: _____

Witnessed: _____

Water lines must be shown on plot plan.
* location for utility meter box is:

**SAMPLE FORM - FOR INFORMATION ONLY
PICK-UP USABLE COPY AT WPOA OFFICE**

NOTICE

NO WATER OR SEWER TAPS/INSTALLATIONS WILL OCCUR UNTIL ROUGH GRADING AND CONSTRUCTION DEBRIS IS REMOVED FROM PROPERTY

WATER WILL BE BILLED THE MONTH FOLLOWING INSTALLATION OF METER REGARDLESS OF USE.

OUPS# _____ DATE: _____

SERVICE INSPECTION: Lot # _____ Date: _____ By: _____

COMMENTS: _____


Meter # _____ Transponder # _____

Revised 3-1-2005



WRWSD CUSTOMER WATER SERVICE REQUIREMENTS

1. Water service lines outside of dwelling must be of 200 psi rated polyethylene (PEP) tubing, or Type K copper tubing.
2. Utility curb valve pigtail extension is $\frac{3}{4}$ " copper tubing size (CTS), 200 psi polyethylene tubing. Connection of customer water service line to utility pigtail shall be with a brass compression coupling (and appropriately sized S.S. tubing inserts when connecting to PEP tubing)
3. A $\frac{3}{4}$ " brass ball valve or $\frac{3}{4}$ " brass gate valve shall be located directly outside of dwelling. The valve shall be connected to customer service line using either a brass compression coupling (with S.S. tubing insert if service line is plastic), or with a brass hose barb connector and stainless steel hose clamps. Galvanized fittings shall not be permitted.
4. Customer ball valve or gate valve shall be located in an 18" diameter by 30" deep plastic or concrete riser with lid, and resting on a 6" deep clean gravel bed. (Proper insulation in winter is recommended)
5. Customer service line and valve are to be buried to a minimum depth of 30 inches.
6. Inspection and signoff of service line and valve by utility department is required before backfilling.

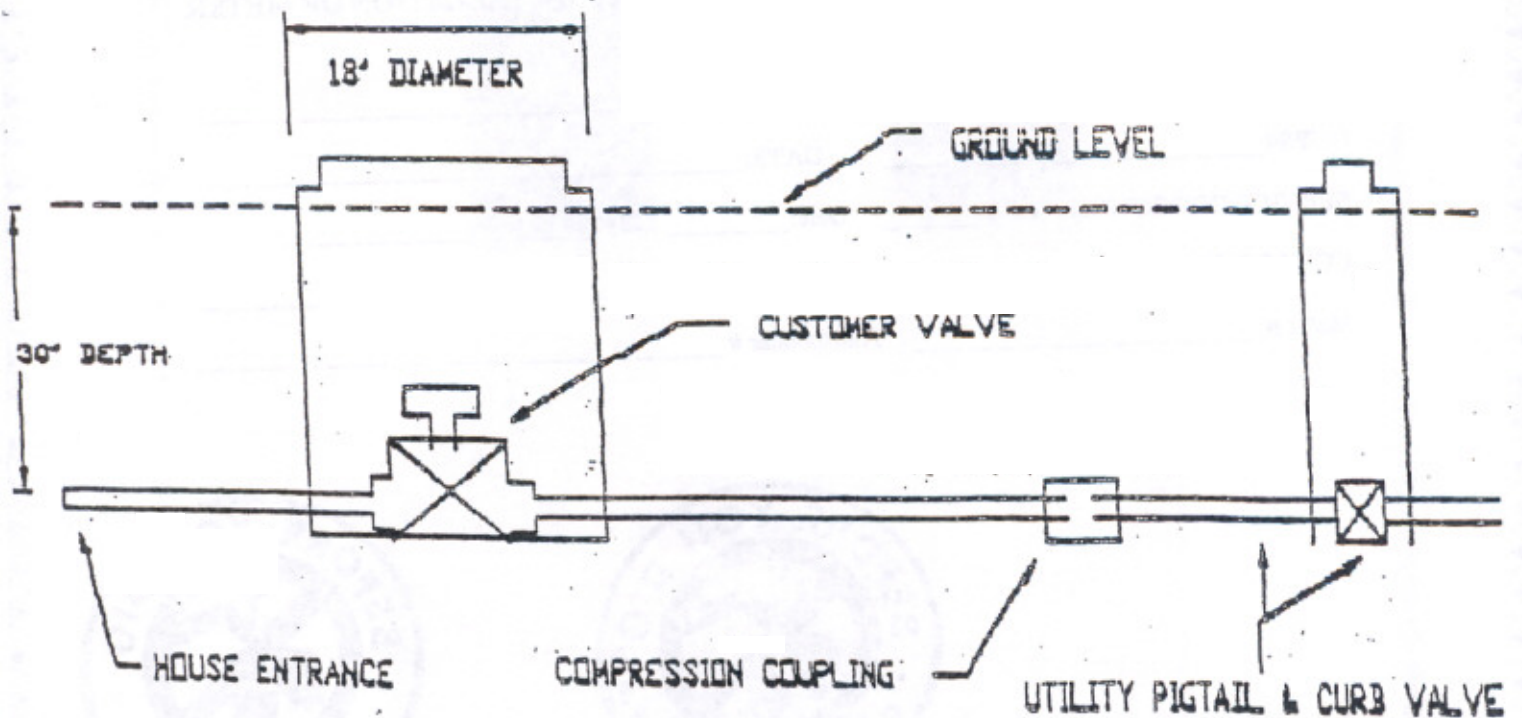

**WAYNOKA RESIDENTIAL WATER SHUT OFF VALVE
AND UTILITY CONNECTION - MATERIAL PARTS LIST**

QUANTITY	ITEM DESCRIPTION
1	30" * 18" DIA RISER
1	18" DIA PLASTIC LID
1	3/4" BRASS GATE VALVE
2	3/4" * 2" BRASS NIPPLES
2	FORD STRAIGHT COUPLING (3/4" FIP * 3/4" IPS COMP)
2	3/4 IPS STAINLESS STEEL INSERTS

NOTE: THE PREVIOUS 3 ITEMS (2 - 3/4" * 2 BRASS NIPPLES; 2 FORD STRAIGHT COUPLINGS;
AND 2 - 3/4" S.S. IPS INSERTS), MAY BE SUBSTITUTED FOR THE NEXT 2 ITEMS:

2	3/4" BRASS HOSE BARB * 3/4" MALE THREAD
4	3/4" STAINLESS STEEL HOSE CLAMPS

FOR CONNECTION OF CUSTOMERS 3/4" 200 PSI IPS TUBING TO UTILITY 3/4" 200 PSI CTS
PLASTIC PIGTAIL, THE FOLLOWING ITEMS ARE REQUIRED:

1	COMPRESSION COUPLING 3/4" IPS * 3/4" CTS
1	3/4" IPS STAINLESS STEEL INSERT
1	3/4" CTS STAINLESS STEEL INSERT